


Generator OR Activation Timeline and Target

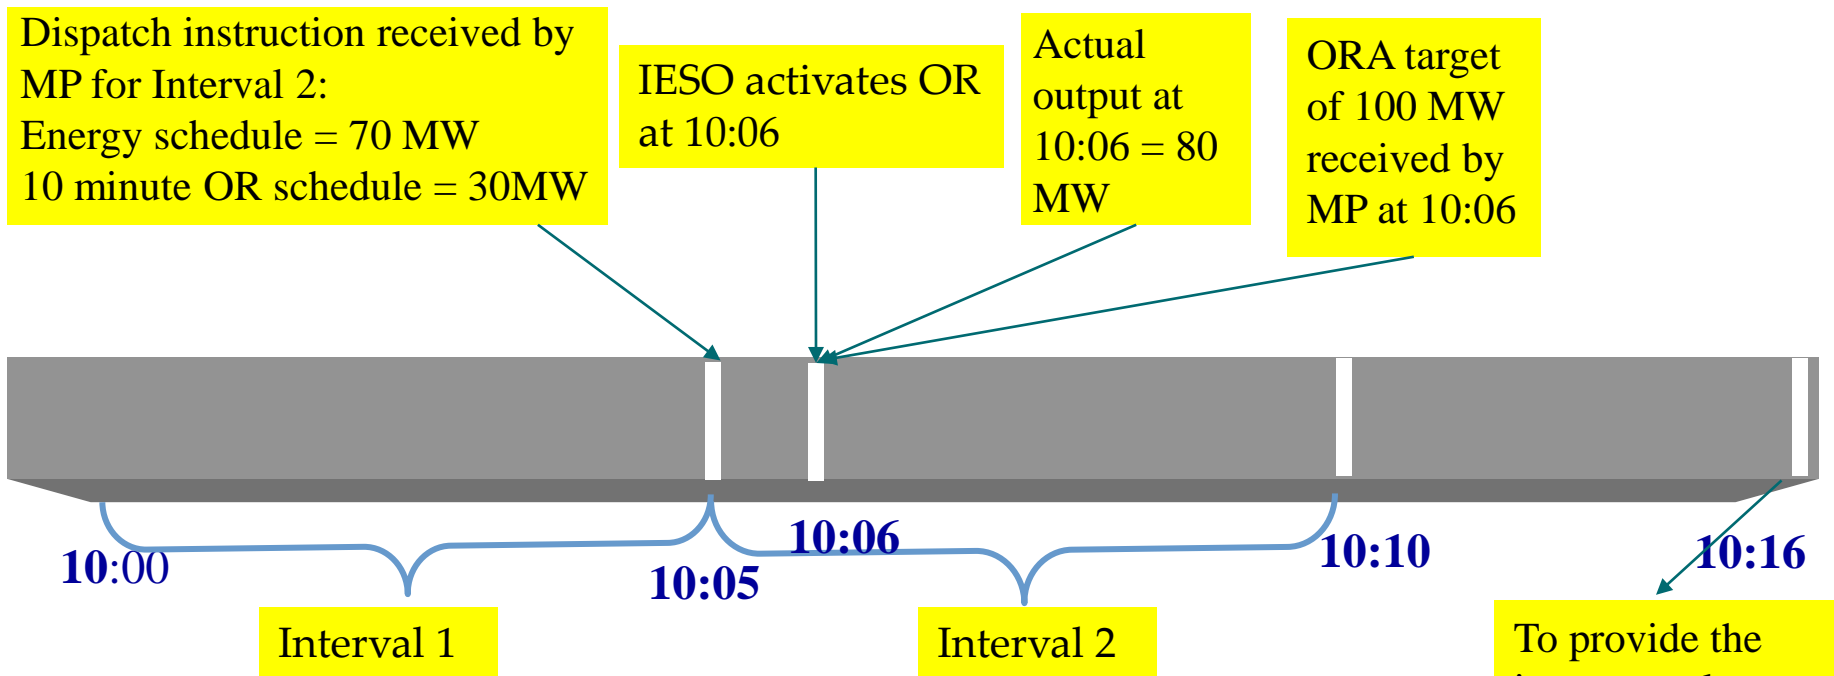

- 1) Pre-activation: Energy Schedule = 70 MW and OR (10 minute) = 30 MW
- 2) During Activation the actual output is 80 MW. Total OR activated was 30 MW
- 3) Post activation: OR activation target expected to be at or above 110 MW

To provide the incremental energy of 30MW by 10:16 the expected output needs to be at or above 110 MW

Dispatchable Load OR Activation Timeline and Target

